


SIZE 10, 3-POSITION VALVE COIL INSTALLATION

Size 10 “S-Coil” Internal Frame Coil

Terminations Include:
Dual Lead, Single Lead, Dual Spade, Single Stud, DIN, Conduit


Required when installing coils:
10170-15 Coil Spacer
10243-72 Coil Retainer Nut

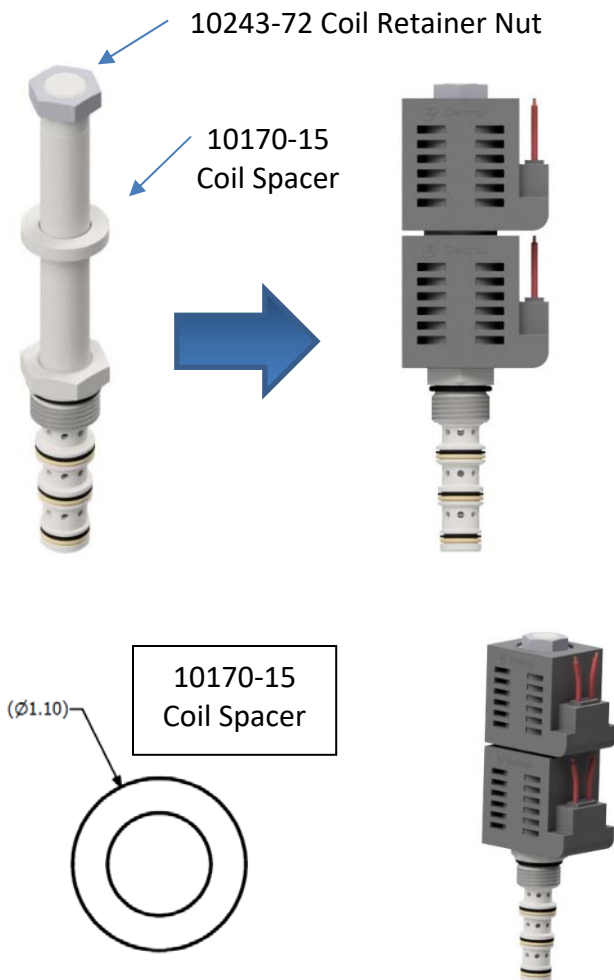

Size 10 “K-Coil” External Frame Coil

Terminations Include:
Dual Lead, Single Lead, Dual Spade, Single Spade, Single Stud, Deutsch, Metri-Pack, Amp Jr Timer, Kostal, DIN

Required when installing coils:
10308-50 Coil Spacer
10243-72 Coil Retainer Nut

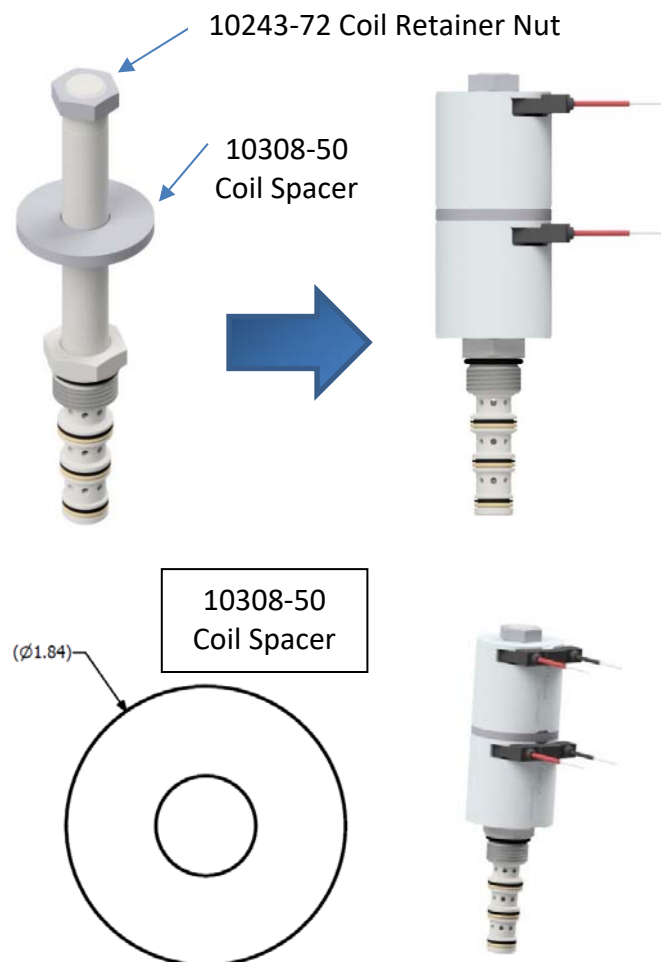

Note for both coil styles:

When installing coil retainer nut, recommended installation torque of 40 IN.-LBS. max.

Coils can be installed in “upside-down” or rotated configurations if required.